
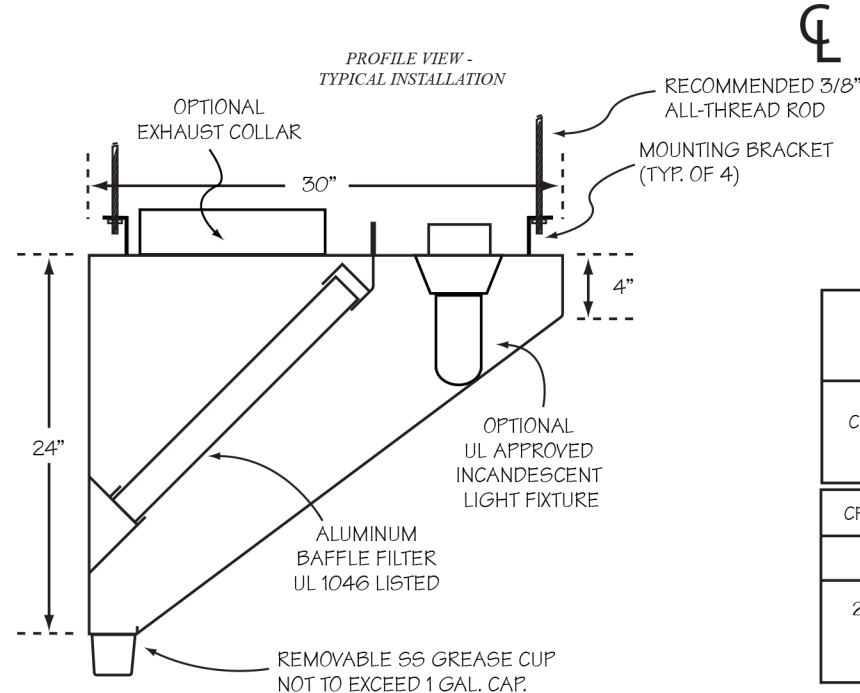


DATE: _____
NAME: _____
LOCATION: _____

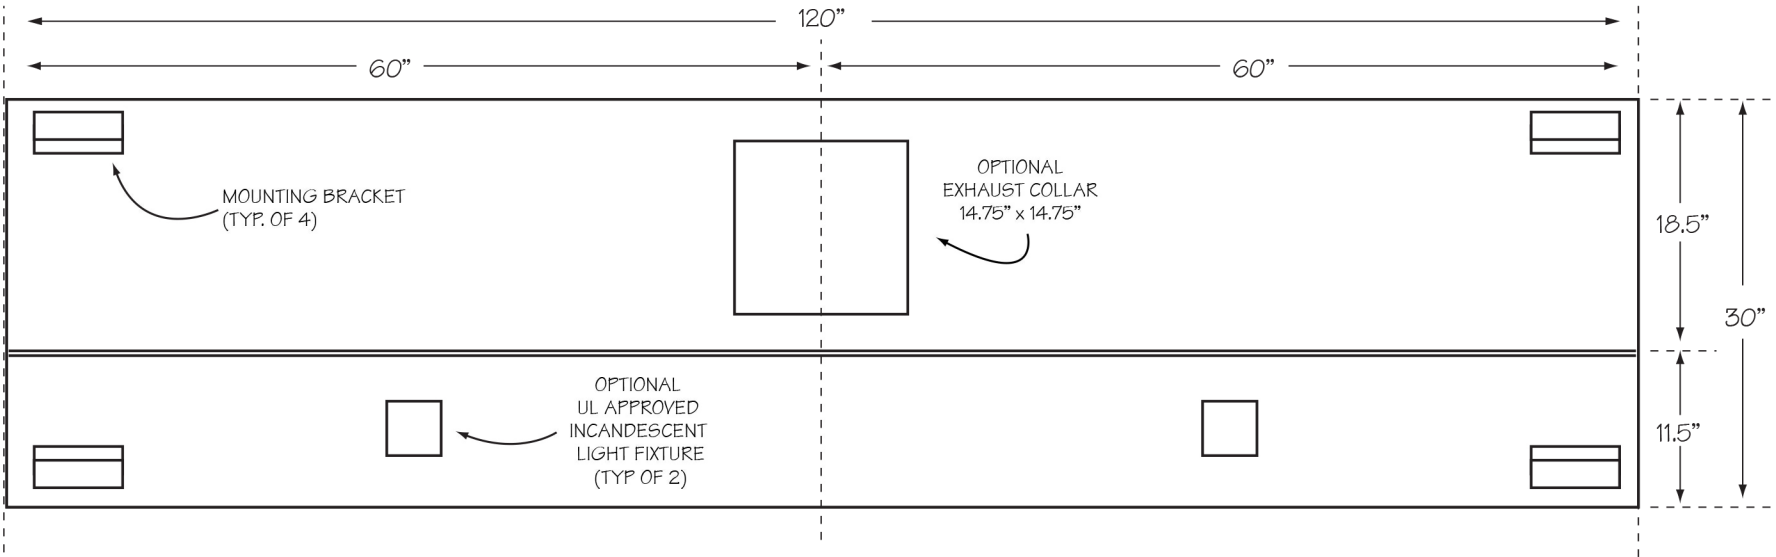

CSS30-10
STAINLESS STEEL EXHAUST HOOD
N.S.F. LISTED. CONFORMS TO NFPA96
Hood Constructed with continuous liquid-tight weld in
conformance to IMC 2012:
*"507.7.1 Type I hoods. External hood joints, seams and penetrations for
Type I hoods shall be made with a continuous external liquid-tight weld
or brace to the lowest outermost perimeter of the hood. Internal hood
joints, seams, penetrations, filter support frames and other appendages
attached inside the hood shall not be required to be welded or braced but
shall be otherwise sealed to be grease tight."*

HOOD INFORMATION

MODEL	LENGTH	WIDTH	HEIGHT	HOOD CONSTRUCTION	FILTERS				LIGHTS	
					TYPE	QTY	HEIGHT	LENGTH	QTY	TYPE
CSS30-10	10'	30"	24"	TYPE: ALL 430 S/S GAUGE: 18 POLISH: #3	ALUMINUM BAFFLE w/HANDLES UL APPROVED	1	20"	20"	2	INCANDESCENT LIGHT FIXTURE UL APPROVED
						4	20"	25"		
CFM REQUIREMENTS (PER HOOD)			COLLARS (PER HOOD)				ACCESSORIES			
EXHAUST	SUPPLY		EXHAUST		SUPPLY		STANDOFF	OTHER:		
2,500 @ .5 S.P.				QTY	SIZE	QTY	SIZE	<input type="checkbox"/> NONE		
				1	14.75" X 14.75"			<input type="checkbox"/> 3"		
								<input type="checkbox"/>		